


Jordan Transformer Radiator Replacement

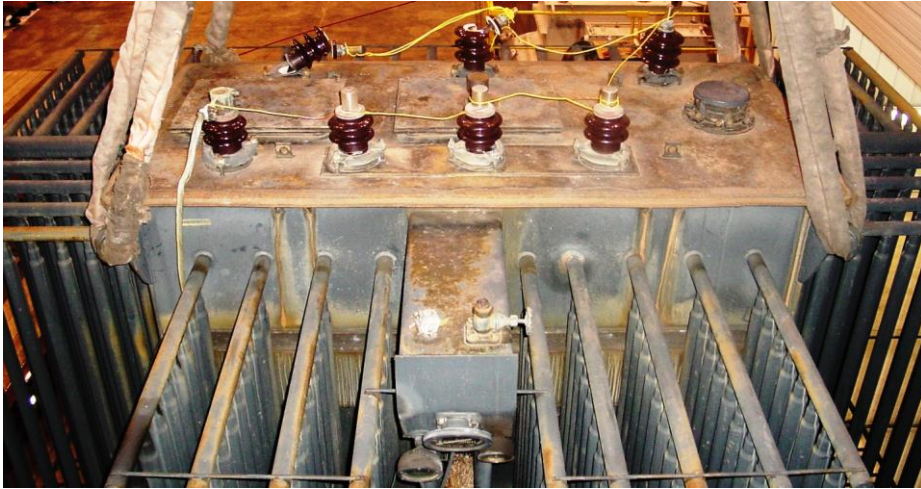


Pre-Remanufacture:

10 MVA OA @ 55° C. 13800 – 4160Y GE made in 1956
with leaky radiators after being used in a corrosive coal
burning power plant environment

Installation of new flanges



Post Remanufacture with all New Detachable Radiators

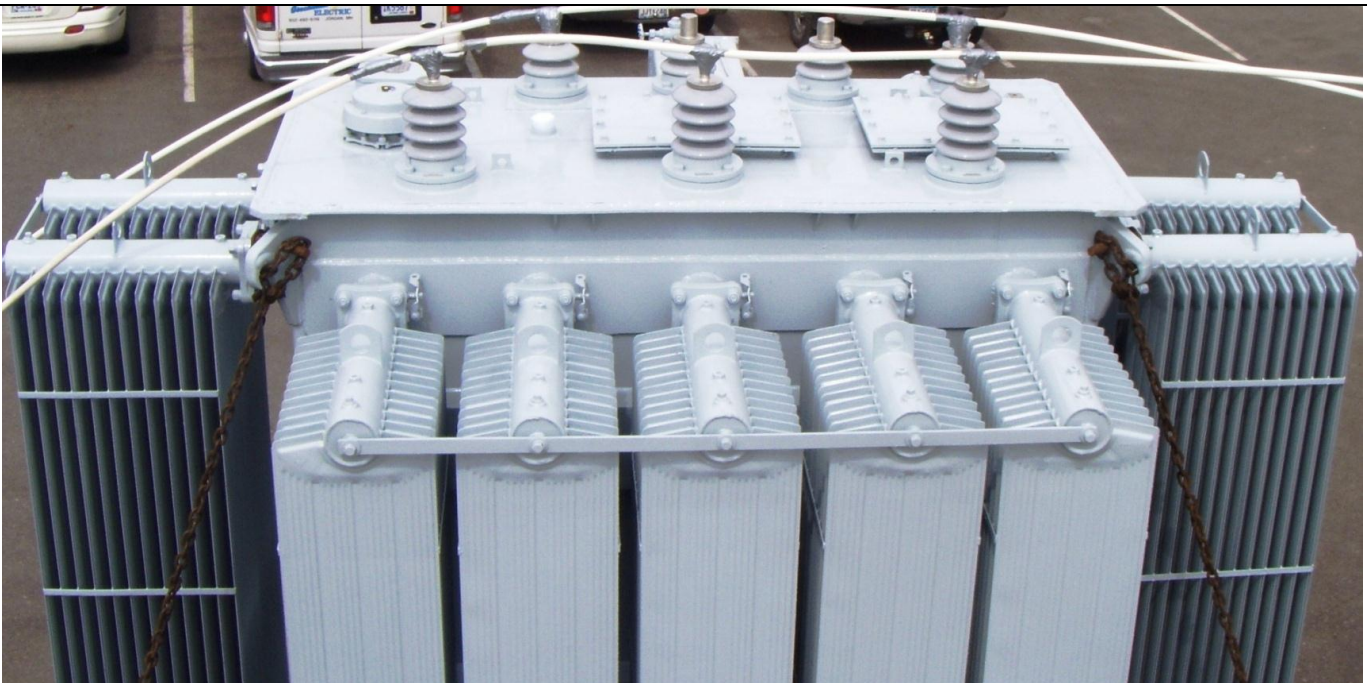

10/11.2 MVA OA @ 55/65° 13800 – 4160Y